

Certificate of Completion

AEROSEAL
Duct Sealing From The Inside

Overall Sealing Results

When we arrived,
YOUR DUCTS HAD:

613.4 CFM of Leakage, equivalent to a
115.9 Square Inch Hole


This equals 368 refrigerators full of air loss every hour.

After we finished,
YOUR DUCTS HAVE:

19.9 CFM of Leakage, equivalent to a
3.8 Square Inch Hole

This corresponds to a **96.8% Reduction** in
Duct Leakage.

Note: Duct Leakage results are calculated in Cubic Feet per Minute (CFM) measured at a standard OPERATING PRESSURE of 25 Pa.

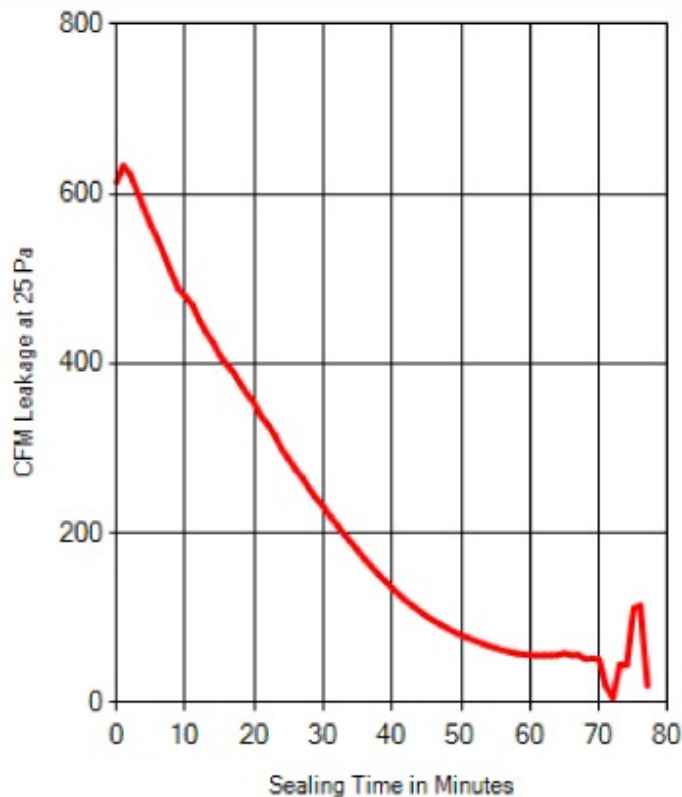

Aeroseal Technician: **marty**

Aeroseal Case ID: **4418**

Date of Seal: **4/25/2017**

System Description: **forced air**

Seal Description: **basement**

Hardware: **HomeSeal**